

Suzhou TRYBA Building Materials Technology Co., Ltd.

TEST REPORT

SCOPE OF WORK

85 Tilt and Turn Window

REPORT NUMBER

251203013SHF-003

TEST DATE(S)

2025-12-11 - 2025-12-12

ORIGINAL ISSUE DATE

2025-12-24

PAGES


20

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10k(January 13, 2025)

© 2025 INTERTEK

Intertek Testing Services Shenzhen Ltd. Shanghai Fengxian Branch

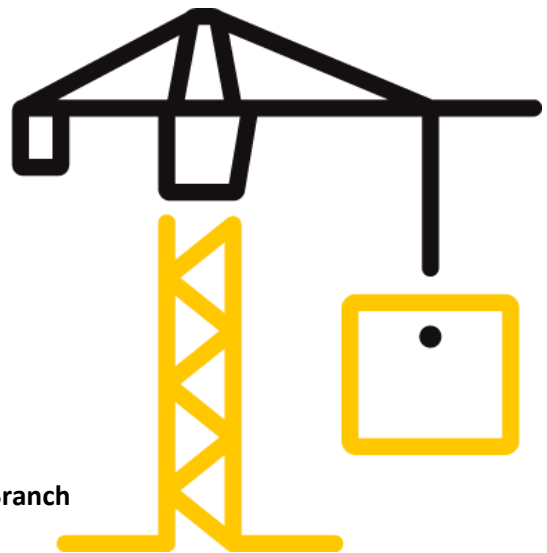

Test Report

Statement

- 1.This report is invalid without company's special seal for testing on the assigned page.
- 2.This report is invalid without an authorized person's signature.
- 3.This report is invalid if altered.
- 4.Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Don't copy this report in partial without any official approval in written by our company. This report is invalid without re-stamping the special seal for testing in copying report.
- 5.This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.
- 6.Except for the obligation, responsibility and liability (if any) for the appropriateness and professionalism of afore-mentioned testing itself within the scope and amount of the testing fee received, Intertek does not and will not accept any other obligation or liability.
- 7.If the Client has any questions about the test results, Intertek B&C should be informed within the storage period of the samples. The sample storage period ends 5 working days after the official report issue date. Samples of certification program are retained for the period required by the certification rules. The samples storage period shall be calculated according to the issue date of the original report in the case of quoting results and modifying reports.
- 8.Intertek B&C will service this report for the entire test record retention period. The test record retention period ends 6 years after this report original issue date. The test record retention period for certification program is 10 years. Test records and other pertinent project documentation will be retained for the entire test record retention period.
- 9.The report was digital signed by Shang Hai, Intertek Group pCW, please using Adobe Acrobat Reader to verify the authenticity.

Test Report

Original Issue Date: 2025-12-24 Intertek Report No. 251203013SHF-003

Applicant: Suzhou TRYBA Building Materials Technology Co., Ltd.
 Applicant Address: 36th floor, Jinhe International Building, 35 Shishan Road, Huqiu District, Suzhou City
 Attn: Alisa
 Manufacturer: TRYBA (Shanghai) Window Co., Ltd.
 Manufacturer Address: No.38, Mingye Road, Sheshan Industrial Park, Songjiang District, Shanghai
 Product Type: Dual-action Window
 Product Model: 85 Energy-saving C Series
 Primary product designator: Class CW - PG50 - Size Tested 1200 × 1800 mm (47.24 × 70.87 in.) - DAW
 Optional secondary designator: Positive Design Pressure = +2400 Pa (50.13 psf)
 Negative Design Pressure = -2400 Pa (50.13 psf)
 Water penetration resistance test pressure = 720 Pa (15.04 psf)

SUBJECT: Performance testing

Product Information

Product Name	Model	Specification
85 Tilt and Turn Window	85 Energy-saving C Series	1200mm(Width) x 1800mm(Height)
Sample ID	Sample Amount	Sample Received Date
S251203013SHF.003	1 Set	2025-12-03
Brand	Sample Description	
TRYBA	The sample was a completely assembled, glazed, functional product (including hardware) and fully operable, fitted in the test apparatus in accordance with documented instructions.	

Test Methods And Standards

Test Standard	ASTM E283/E283M-2019; ASTM E547-00(R2016); ASTM E330/E330M-2014(R2021); ASTM F588-17; AAMA/WDMA/CSA101/I.S.2/A440-22 Clause 8.3.1 and Clause 8.3.6.6
Specification Standard	AAMA/WDMA/CSA 101/I.S.2/A440-22 (NAFS 2022 - North American Fenestration Standard / Specification for Windows, Doors and Skylights) Clause 8.3.1, Clause 8.3.2, Clause 8.3.3, Clause 8.3.4, Clause 8.3.5 and Clause 8.3.6.6; CSA A440S1-25 Canadian Supplement to AAMA/WDMA/CSA 101/I.S.2/A440-22 Clause 5.3 and Clause 5.4
Test Conclusion	The results met AAMA/WDMA/CSA 101/I.S.2/A440-22 and CSA A440S1-25 requirements specified on Dual-action Window, and the results were shown in the following page.

Note:

- 1.This report does not involve sampling. The report only reflects conformity of the tested items of the samples provided by the testing applicant. Representativeness and authenticity of the submitted samples are responsibilities of the testing applicant.
2. This test item was conducted in one of our multi-sites address of Plant 3-5, No. 6978 Daye Road, Fengxian District, Shanghai (No. 4-South Plant, No. 161 Litai Road).

Report Authorized



 Name: Gio Liu Name: John Zhang
 Title: Reviewer Title: Project Engineer

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Test Items, Method and Results:

2 Test Result

Table 2 Test Result

Test Description	Requirements (Class CW-PG50)		Results		Verdict
2025/12/11					
Operating Force Test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.1	Turn inward operation				Pass
	Maximum force to initiate motion	155 N	Maximum force to initiate motion	42 N	
	Maximum force to maintain motion	155 N	Maximum force to maintain motion	23 N	
	Maximum force to initiate motion for Operators	Reported	Maximum force to initiate motion for Operators	32 N	Reported
	Maximum force to maintain motion for Operators	Reported	Maximum force to maintain motion for Operators	19 N	
	Tilt inward operation				Pass
	Maximum force to initiate motion	155 N	Maximum force to initiate motion	52 N	
	Maximum force to maintain motion	155 N	Maximum force to maintain motion	33 N	
	Maximum force to initiate motion for Operators	Reported	Maximum force to initiate motion for Operators	34 N	Reported
	Maximum force to maintain motion for Operators	Reported	Maximum force to maintain motion for Operators	25 N	
Air Leakage Resistance Test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.2 ASTM E283/E283M-2019	Maximum air leakage at +75 Pa	1.0 L/s·m ²	Air leakage at +75 Pa	0.12 L/s·m ²	Pass
	Maximum air leakage at -75 Pa	1.0 L/s·m ²	Air leakage at -75 Pa	0.10 L/s·m ²	
Water Penetration Resistance Test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.3 ASTM E547-00 (R2016)	Minimum water pressure	360 Pa	Test Pressure	720 Pa	Pass
			After water sprayed for four cycles in 24 minutes at 720 Pa, no water penetration was observed.		

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Table 2 Test Result (Continued)

Test Description	Requirements (Class CW-PG50)		Results		Verdict
2025/12/11					
Uniform Load Deflection Test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.4.2 ASTM E330/E330M-2014(R2021)	Minimum Design Pressure (DP)	2400 Pa	Design Pressure (DP)	+2400 Pa	Pass
			Maximum deflection at Stile	0.7 mm	
			Maximum deflection at Bottom Rail	0.5 mm	
			Design Pressure (DP)	-2400 Pa	
			Maximum deflection at Stile	0.3 mm	
			Maximum deflection at Bottom Rail	0.5 mm	
Uniform Load Structural Test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.4.3 ASTM E330/E330M-2014 (R2021)	Minimum Structural Pressure (STP)	3600 Pa	Structural Pressure (STP)	+3600 Pa	Pass
			No significant breakage or damage after ultimate strength was released.		
			Maximum permanent deformation at Stile	<0.1 mm	
			Maximum permanent deformation at Bottom Rail	0.1 mm	
			Structural Pressure (STP)	-3600 Pa	
			No significant breakage or damage after ultimate strength was released.		
			Maximum permanent deformation at Stile	<0.1 mm	
			Maximum permanent deformation at Bottom Rail	0.1 mm	
2025/12/12					
Forced-entry Resistance Test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.5 ASTM F588-17	Minimum Grade 10		Test Class	Grade 10	Pass
			During the test and upon removal of loads, all locking devices were remained engaged and could not entry.		
Awning, hopper, projected hardware load test AAMA/WDMA/CSA 101/I.S.2/A440-22, Clause 8.3.6.6	Load to the sash	140 N	Deflection Measured	2.13 mm	Pass
	Deflection Limit	38.3 * A = 75.8 mm	After test, the sample does not be damaged in any way that would inhibit normal operation and there was no glazing breakage.		

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Appendix B: Test Data

B.1 Air Leakage Resistance Test – Test method ASTM E283/E283M-2019

Overall Area: 2.16 m²

Table B.1 Test Data of Air Leakage Resistance Test

Infiltration rate (75 Pa)	0.12 L/s·m ²	0.02 cfm/ft ²
Exfiltration rate (75 Pa)	0.10 L/s·m ²	0.02 cfm/ft ²
Requirements (75 Pa): Maximum allowable leakage for Class CW Windows	1.0 L/s·m ²	0.2 cfm/ft ²

The tested specimen met the requirements for Class CW Windows for Air Leakage Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-22.

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Appendix B: Test Data

B.2 Water resistance test – Test method ASTM E547-00(R2016)

No water penetration occurred when the pressure was 720 Pa (15.04 psf).

After water sprayed for four cycles in 24 minutes at 720 Pa, no water penetration was observed.

Test result: $P_{\max} = 720 \text{ Pa (15.04 psf)}$.

The tested specimen met the requirements for Class CW-PG50 for Water Penetration Resistance Test as per AAMA/WDMA/CSA 101/I.S.2/A440-22.

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Appendix B: Test Data

B.3 Uniform Load Deflection Test – Test method ASTM E330/E330M-2014(R2021), Procedure A

Span length, L = 1620 mm Set Points (1-3)

Span length, L = 1020 mm Set Points (3-5)

Test Pressure (DP), P = 2400 Pa (50.13 psf)

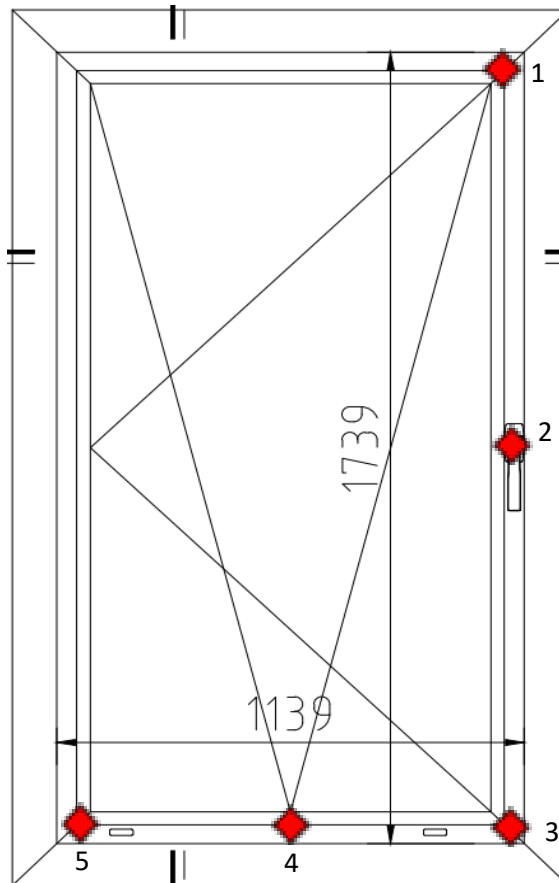


Fig.8 Locations of Displacement Measuring Devices

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Table B.2 Test Data of Uniform Load Deflection Test

Member (mm)		Test Pressure (Pa)	Deflection (mm)			Maximum Deflection(mm)
Item	Span Length		1	2	3	
Stile	1620	+P = 2400	0.5	1.1	0.4	0.7
		0	0.1	0.2	0.1	0.1
		-P = -2400	0.8	1.0	0.6	0.3
		0	0.1	<0.1	<0.1	<0.1
Member (mm)		Test Pressure (Pa)	Deflection (mm)			Maximum Deflection(mm)
Item	Span Length		3	4	5	
Bottom Rail	1020	+P = 2400	0.4	1.0	0.6	0.5
		0	0.1	0.1	0.1	<0.1
		-P = -2400	0.6	1.5	1.4	0.5
		0	<0.1	0.3	0.5	0.1

Table B.3 Test Data of Uniform Load Deflection Test for Stile

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Maximum Deflection		Maximum Deflection	
2400 Pa (50.13 psf)	0.7	(0.03)	0.3	(0.01)
Span length, L =	1620 mm	(63.78 in.)	Deflection limit L/175 =	9.3 mm (0.36 in.)

Table B.4 Test Data of Uniform Load Deflection Test for Bottom Rail

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Maximum Deflection		Maximum Deflection	
2400 Pa (50.13 psf)	0.5	(0.02)	0.5	(0.02)
Span length, L =	1020 mm	(40.16 in.)	Deflection limit L/175 =	5.8 mm (0.23 in.)

The tested specimen met the requirements for Class CW-PG50 for Uniform Load deflection Test at Design Pressure as per AAMA/WDMA/CSA 101/I.S.2/A440-22.

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Appendix B: Test Data

B.4 Uniform Load Structural Test – Test method ASTM E330/E330M-2014(R2021), Procedure A

Design Pressure, P = 2400 Pa (50.13 psf)

Structural Pressure, P = 3600 Pa (75.19 psf)

Table B.5 Test Data of Uniform Load Structural Test

Member (mm)		Test Pressure (Pa)	Permanent deformation(mm)			Maximum permanent deformation(mm)
Item	Span Length		1	2	3	
Stile	1620	+P = 3600	–	–	–	–
		0	0.3	0.2	0.1	<0.1
		-P = -3600	–	–	–	–
		0	0.1	<0.1	0.1	<0.1
Permanent Deformation limit, L x 0.3% = 4.9 mm						
Member (mm)		Test Pressure (Pa)	Permanent deformation(mm)			Maximum permanent deformation(mm)
Item	Span Length		3	4	5	
Bottom Rail	1020	+P = 3600	–	–	–	–
		0	0.1	0.4	0.5	0.1
		-P = -3600	–	–	–	–
		0	0.1	0.4	0.6	0.1
Permanent Deformation limit, L x 0.3% = 3.1 mm						

Table B.6 Test Data of Uniform Load Structural Test For Stile

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Perm. Set		Perm. Set	
3600 Pa (75.19 psf)	<0.1	(<0.01)	<0.1	(<0.01)

Table B.7 Test Data of Uniform Load Structural Test For Bottom Rail

Test Pressure	Deflection Measurements, mm (in.)			
	Positive		Negative	
	Perm. Set		Perm. Set	
3600 Pa (75.19 psf)	0.1	(<0.01)	0.1	(<0.01)

After the test loads were released, there was no failure or permanent deformation of any part of the window system that would cause the test specimen to be inoperable. There was no permanent deformation which was in excess of 0.3% of its span.


The tested specimen met the requirements for Class CW-PG50 for Uniform Load Structure Test at Structural Pressure as per AAMA/WDMA/CSA 101/I.S.2/A440-22.

Test Report

Original Issue Date: 2025-12-24

Intertek Report No. 251203013SHF-003

Appendix C: Sample Received Photo

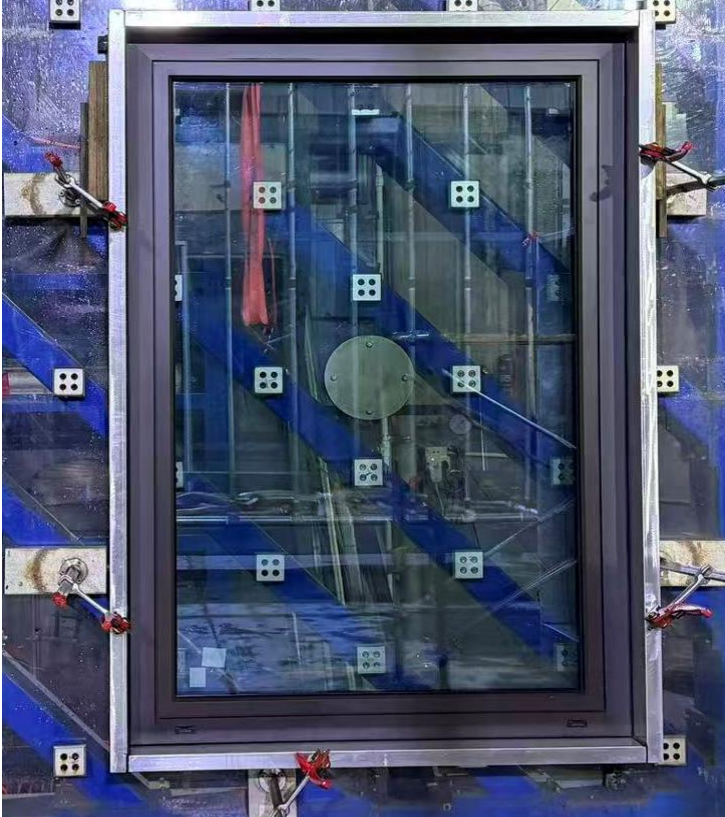

Revision:

NO.	Date	Changes
251203013SHF-003	2025-12-24	First issue